

## MULTILEVEL CONVERTER BASED ON POWER QUALITY INTEGRATION OF ENERGY RESOURCES CONTROL SYSTEM

Anant Kumar<sup>1</sup>, Prof. Ragini Singh<sup>2</sup>

<sup>1,2</sup> Department of Electrical and Electronics Engineering, MITS, Bhopal

anant7415@gmail.com, raginis300@gmail.com

### ABSTRACT:

The power electronics device which converts DC power to AC power at required output voltage and frequency level is known as Converter. Converters can be broadly classified into single level Converter and multilevel Converter. Multilevel Converter as compared to single level Converters have advantages like minimum harmonic distortion, reduced EMI/RFI generation and can operate on several voltage levels. A multi-stage Converter is being utilized for multipurpose applications, such as active power filters, static VAR compensators and machine drives for sinusoidal and trapezoidal current applications. The drawbacks are the isolated power supplies required for each one of the stages of the multi Converter and it's also lot harder to build, more expensive, harder to control in software. This project aims at the simulation study of three phase single level and multilevel Converters. The role of Converters in active power filter for harmonic filtering is studied and simulated in MATLAB/SIMULINK. Firstly, the three phase system with non-linear loads is modeled and their characteristics are observed. Secondly, the active power filters are modeled with the Converters and suitable switching control strategies (PWM technique) to carry out harmonic elimination.

**Keywords:** Multilevel Converter, harmonic, transmission lines, photovoltaic

### 1. INTRODUCTION

When AC loads are fed through Converters it required that the output voltage of desired magnitude and frequency be achieved. A variable output voltage can be obtained by varying the input DC voltage and maintaining the gain of the Converter constant. On the other hand, if the dc input voltage is fixed and it is not controllable, a variable output voltage can be obtained by varying the gain of the Converter, which is normally accomplished by pulse-width-modulation (PWM)

control within the Converter. The Converters which produce which produce an output voltage or a current with levels either 0 or +V are known as two level Converters. In high-power and high-voltage applications these two-level Converters however have some limitations in operating at high frequency mainly due to switching losses and constraints of device rating. This is where multilevel Converters are advantageous. Increasing the number of voltage levels in the Converter without requiring higher rating on individual devices can increase power rating. The unique structure of multilevel voltage source Converters' allows them to reach high voltages with low harmonics without the use of transformers or series-connected synchronized-switching devices. The harmonic content of the output voltage waveform decreases significantly. Multilevel Converters have been under research and development for more than three decades and have found successful industrial applications. However, this is still a technology under development, and many new contributions and new commercial topologies have been reported in the last few years.

The aim of this paper is to group and review recent contributions, in order to establish the current state of the art and trends of the technology to provide readers with a comprehensive and insightful review of where multilevel Converter technology stands and is heading. This chapter first presents a brief overview of well-established multilevel Converters strongly oriented to their current state in industrial applications and then centers the discussion on the new multilevel Converters that have made their way into the industry. Multilevel Converters have been attracting increasing interest recently the main reasons are; increased power ratings, improved harmonic performance, and reduced electromagnetic interference (EMI) emission that can be archived with multiple dc levels that are synthesis of the output voltage waveform. In particular multilevel Converters have abundant demand in applications such

as medium voltage industrial drives, electric vehicles, and grid connected photovoltaic systems. The present work provides a solution to design an efficient multilevel topology which is suited for medium and high power applications. In the subsequent sections the research background is discussed in detailed. Motivation and objectives are clearly outlined. There are different power Converter topologies and control strategies used in Converter designs. Different design approaches address various issues that may be more or less important depending on the way that the Converter is intended to be used. The issue of waveform quality is one the important concern and it can be addressed in many ways. In practice capacitors and inductors can be used to filter the waveform [1-2].

If the design includes a transformer, filtering can be applied to the primary or the secondary side of the transformer or to both sides. Low-pass filters are applied to allow the fundamental component of the waveform to pass to the output while limiting the passage of the harmonic components. Thus quality of waveform can be adjusted. Note that, normal Converters always generate very low quality output waveforms. To make the output waveform qualitative, low pass (LC filter) are often added in the circuit. Thus, at this point of time readers might have a question that, why the quality of Converter output is low? And why Low pass filter are frequently added in the circuit. Further, what kinds of solutions are available to increase quality of output waveform without losing its efficiency? All this are open problems associated with present day Converters. However, eventually all this will be addressed in this thesis. But at first we try to figure out the Converter applications from low power to high power and then we summarize the requirements to meet the high power demand. Finally we try to present the problems and solutions available to meet the high power demand. From it is quite predictable that, power Converters is an enabling technology. They are potentially useful for a wide range of applications like; low power devices, home appliances, electric vehicles, photovoltaic, transport (train traction, ship propulsion, and automotive applications), and energy conversion, manufacturing, mining, and petrochemical applications. The Converters mentioned in are available in a wide range. Note that, either it may be suited for DC or AC. But, at present industries are in chase of finding new type of power Converter for medium to high power range, moreover it seems to be challenging issues for present generation researchers

## 2. POWER CONVERTERS

Although research pioneers have built a numerous power Converters, but still researchers are in look for a new sort of architecture which can produce high quality

waveform with less number of components. In other terms improving power quality is the greatest requirement. By considering above aspects, let us make an outline regarding the demanding aspects of power Converters, particular in Medium and high power range.

	Low Power	Medium Power	High Power
Power Range	Up to 1 kW	2-500 kW	More Than 500 kW
Class Converter Topology	ac/dc, dc/dc	ac/dc, dc/dc, dc/ac	ac/dc, dc/ac
Typical Power Semiconductor	IGBT	MOSFET, IGBT	IGBT, SiC, Thyristor
Technology Trend	High Power Density, High Efficiency	Small Volume and Weight, Low Cost and High Efficiency	High Nominal Power of the Converter, High Power Quality and Stability
Typical Applications	Low-Power Devices Home Appliances	Electric Vehicles Renewable PV	Transportation Renewable Energy Industry Power Distribution

Fig.1: Power Converters

The current energy arena is changing. The feeling of dependence on fossil fuels and the progressive increase of its cost is leading to the investment of huge amounts of resources, economical and human, to develop new cheaper and cleaner energy resources not related to fossil fuels [3]. In fact, for decades, renewable energy resources have been the focus for researchers, and different families of power Converters have been designed to make the integration of these types of systems into the distribution grid a current reality. Besides, in the transmission lines, high-power electronic systems are needed to assure the power distribution and the energy quality. Therefore, power electronic Converters have the responsibility to carry out these tasks with high efficiency. The increase of the world energy demand has entailed the appearance of new power Converter topologies and new semiconductor technology capable to drive all needed power. A continuous race to develop higher-voltage and higher-current power semiconductors to drive high-power systems still goes on. However, at present there is tough competition between the use of classic power Converter topologies using high-voltage semiconductors and new Converter topologies using medium-voltage devices.

Power Converters are an amazing technology for industrial practice powered by electric drive systems. They are potentially helpful for a wide range of applications: transport (train traction, ship propulsion, and automotive applications), energy conversion, manufacturing, mining, and petrochemical, to name a few. Many of these processes have been continuously

raising their demand of power to reach higher production rates, cost reduction (large-scale economy), and efficiency [4]. The power electronics research community and industry have reacted to this demand in two different ways: developing semiconductor technology to reach higher nominal voltages and currents (currently 8 kV and 6 kA) while maintaining traditional Converter topologies (mainly two-level voltage and current source Converters); and by developing new Converter topologies, with traditional semiconductor technology, known as multilevel Converters [5]. The first approach inherited the benefit of well known circuit structures and control methods. Adding to that, the newer semi-conductors are more expensive, and by going higher in power, other power-quality requirements have to be fulfilled, thereby there may be need of additional power filters. Therefore it will be quite feasible to choose to build a new Converter topology based on multilevel concept. This is the challenging issue right now At present there is tough competition between the use of classic power Converter topologies using high-voltage semiconductors and new Converter topologies using medium-voltage devices. This idea is shown in Fig. 2 where Converters are built by adding devices in series. In past, these Converters are only viable options for medium and high-power applications. But in present scenario, multilevel technology with medium voltage semiconductors are fighting in a development race with classic power Converters using high-power semiconductors, which are under continuous development and are not mature. Although, classical Converters are good for low power applications, but they fail to fill the requirements of high-power levels.

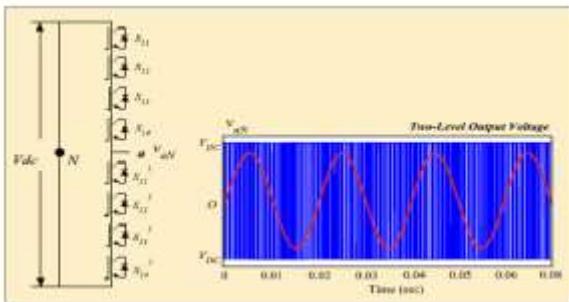


Fig.2: Classical Converter and output waveform

In view of later, to retrieve the demerits of classical Converters we should know about the multilevel technology and the merits it offer. Multilevel Converters are a good alternative for power applications due to the fact that, they can achieve high power using mature medium-power semiconductor technology. Practically, multilevel Converters present great advantages compared with conventional and very well-known two-level Converter. These advantages are

fundamentally focused on improvements in the output signal quality (Voltage & Current) and a nominal power increase in the Converter [6]. These properties make multilevel Converters very attractive to the industry and, nowadays, researchers all over the world are spending great efforts trying to improve multilevel Converter performances such as the control simplification and the performance of different optimization algorithms in order to enhance the THD [7] of the output signals, the balancing of the dc capacitor voltage [8], and the ripple of the currents. For instance, nowadays researchers are focused on the harmonic elimination using pre-calculated switching functions, harmonic mitigation to fulfill specific grid codes, the development of new multilevel Converter topologies (hybrid or new ones), and new control strategies [9]. However, before introducing about the multilevel Converters, let's make an overview about the classical Converters and their problems. To address the problems of conventional Converters, one should have an idea about the Medium to high-power range Converters and related challenging issues. Below are some of the facts summarized.

1. At present, application power range of Converter circuits using the basic "Converter leg" building block is vast (<1 kW to 10 MW+)
2. Very large application area is in industrial (PWM controlled induction motor) drives (See Fig.3) are around 3 kW to 100 kW power range. IGBT devices are used almost exclusively in this power range.
3. Recently the application area for these circuits has extended to power levels (>1 MW), Most importantly,

### 3. WIND POWER

With increasing energy demands, wind energy becomes a very popular option due to the recent change in the public opinion towards protecting the environment. And it is also viewed as a safe energy source that does not rely on any limited resources. Wind power is harnessed when wind forces the turbine blades to rotate. The spinning of the blades rotates the rotor of the motor, which generates electricity through the wind turbine generator.

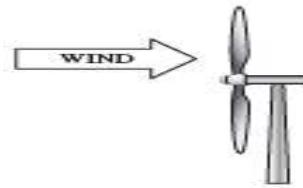


Fig.3: Wind turbine model

This motion is then converted into electrical power delivered to the grid. In recent decades, wind energy

technology has rapidly evolving with the increasing demands for wind power plant stability. This section will discuss the stability of the variable speed double fed induction generator (DFIG) wind turbine in wind power plant. Wind turbine produces electricity by using the power of the wind to drive an electrical generator. Wind passes over the blades to exerting turning forces to turn the shaft inside the wind turbine, which goes into a gearbox. The gearbox increases the rotational speed to induce a magnetic field in the generators, and then converted into electrical energy.

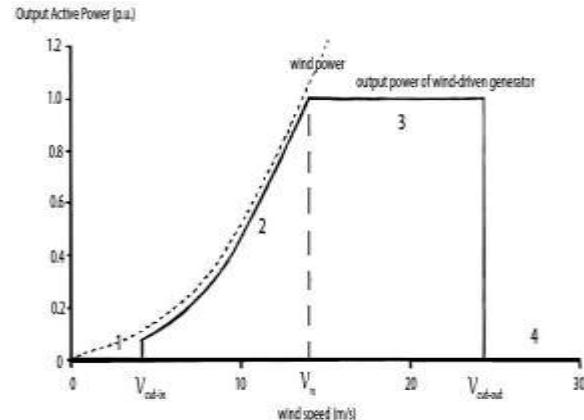


Fig.4: Wind turbine power generation v s wind speed

The graph gave three key factors on the characteristic of wind turbine power output: Cut-in wind speed: the minimum wind speed at which the machine will deliver power.

1. Rated wind speed: the wind speed at which rated power of wind turbine is obtained. The rated power is the maximum power output of the wind turbine generator.
2. Cut-out wind speed: The maximum wind speed at which the turbine is allowed to deliver power or the limited wind speed a wind turbine can operate. These characteristics described above are varied depending on the type of wind turbine.

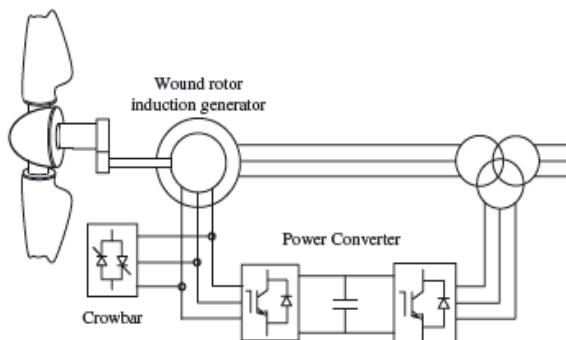


Fig.5: DFIG wind turbine model

DFIG wind turbine deliver power through the stator and rotor of the generator, while the rotor can also absorb power depends on the rotational speed of the generator. If the generator operates above synchronous speed, the power is delivered from the rotor through the power converter to the grid. If the generator operates below synchronous speed, then the rotor will absorb power from the grid through the power converter. The power converter consists of a Rotor-side Converter (RSC) and a Grid-side Converter (GSC). The power converter controls the active and reactive power flow, and the DC voltage of the DC-link capacitor between the DFIG wind turbine and the grid by feeding the pulse width modules (PWM) to the converters (Seyedi, 2009). In addition a crowbar is implemented to prevent short circuit in the wind energy system that result in high current and high voltage. The RSC converter operates at the slip frequency that depends on the rotor speed, and controls the flux of the DFIG wind turbine.

#### 4. RESULT

The power rating of the RSC is determined according to the maximum active and reactive power control capability. The RSC can be simplified as a current-controlled voltage source converter. The GSC operates at a network frequency and controls the voltage and current level in the DC-link circuit. It is used to regulate the voltage of one of the important requirements for wind power plant is providing fault ride-through capabilities. This means that the wind power plant must withstand voltage dips to certain percentage of the nominal voltage and for a specific duration. In other word wind farm must not be disconnected from the grid during a fault or short circuit.

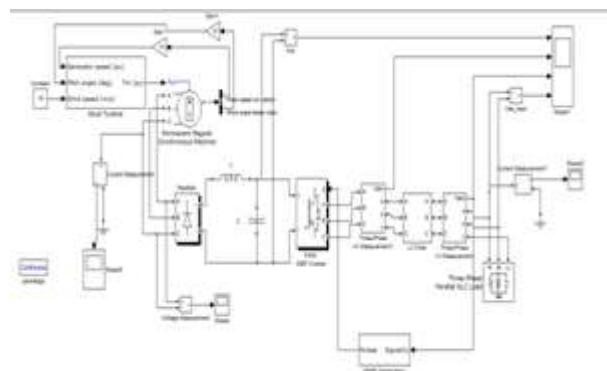


Fig.6: power Converter Block

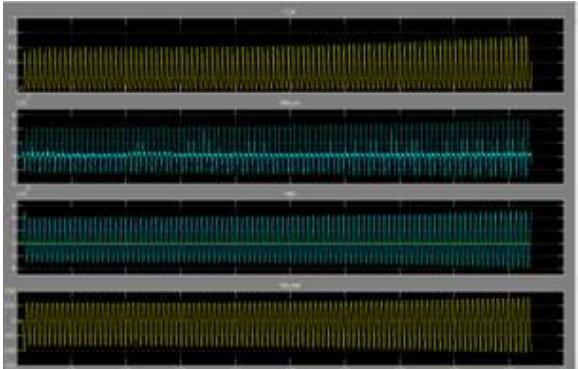


Fig.7: power Converter waveform.

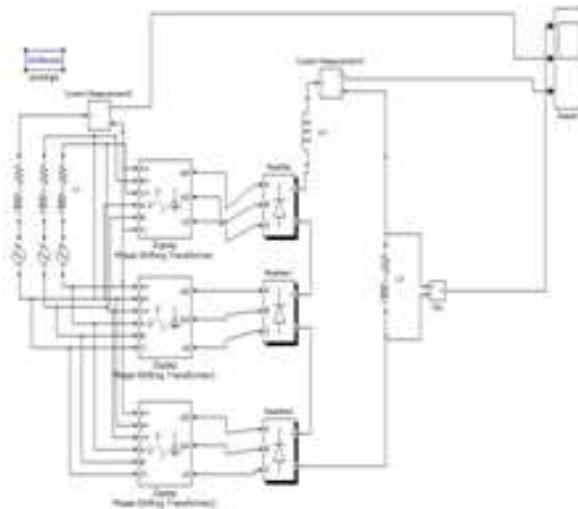


Fig.8: level Converter Block

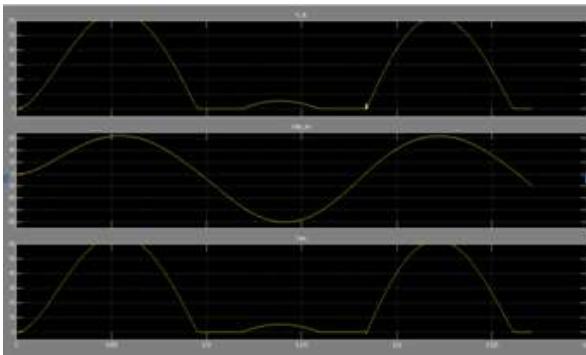


Fig.9: level Converter waveform.

## CONCLUSION

This Paper has demonstrated the state of the art of multilevel power Converter technology. Fundamental multilevel Converter structures and modulation paradigms including the pros and cons of each technique have been discussed. Most of the thesis focus has addressed modern and more practical industrial applications of multilevel Converters. It should be noted that this thesis could not cover all multilevel power Converter related applications; however the

basic principles of different multilevel Converters have been discussed methodically. The main objective of this thesis is to provide a general notion about the multilevel power Converters and various modulation strategies mainly PWM techniques and their applications. We deduced possible switching states in six level diode clamped and flying capacitor Converters the general concept of multilevel power conversion was introduced more than twenty years ago. However, most of the

## REFERENCES

- [1] J. Rodriguez, J.-S. Lai, and F. Z. Peng, "Multilevel Converters: A survey of topologies, controls, and applications," *IEEE Trans. Ind. Electron.*, vol. 49, no. 4, pp. 724–738, Aug. 2002.
- [2] H. Abu-Rub, J. Holtz, J. Rodriguez, and G. Baoming, "Medium-voltage multilevel Converters—State of the art, challenges, and requirements in industrial applications," *IEEE Trans. Ind. Electron.*, vol. 57, no. 8, pp. 2581–2596, Aug. 2010.
- [3] J.-S. Lai and F. Z. Peng, "Multilevel Converters—A new breed of power Converters," *IEEE Trans. Ind. Appl.*, vol. 32, no. 3, pp. 509–517, May/Jun. 2009.
- [4] M. Malinowski, K. Gopakumar, J. Rodriguez, and M. A. Perez, "A survey on cascaded multilevel Converters," *IEEE Trans. Ind. Electron.*, vol. 57, no. 7, pp. 2197–2206, Jul. 2010.
- [5] J. Rodriguez, L. G. Franquelo, S. Kouro, J. I. León, R. C. Portillo, M. A. M. Prats, and M. A. Perez, "Multilevel Converters: An enabling technology for high-power applications," *Proc. IEEE*, vol. 97, no. 11, pp. 1786–1817, Nov. 2009.
- [6] G. Bergna, E. Berne, P. Egrot, P. Lefranc, A. Arzande, J.-C. Vannier, and M. Molinas, "An energy-based controller for HVDC modular multilevel Converter in decoupled double synchronous reference frame for voltage oscillation reduction," *IEEE Trans. Ind. Electron.*, vol. 60, no. 6, pp. 2360–2371, Jun. 2013.
- [7] Z. Shu, N. Ding, J. Chen, H. Zhu, and X. He, "Multilevel SVPWM with DC-link capacitor voltage balancing control for diode-clamped multilevel Converter based STATCOM," *IEEE Trans. Ind. Electron.*, vol. 60, no. 5, pp. 1884–1896, May 2013.
- [8] J. Chavarria, D. Biel, F. Guinjoan, C. Meza, and J. J. Negroni, "Energybalance control of PV cascaded multilevel grid-connected Converters under level-shifted and phase-shifted PWMs," *IEEE Trans. Ind. Electron.*, vol. 60, no. 1, pp. 98–111, Jan. 2013.

- [9] G. Buticchi, E. Lorenzani, and G. Franceschini, "A five-level single-phase grid-connected Converter for renewable distributed systems," *IEEE Trans. Ind. Electron.*, vol. 60, no. 3, pp. 906–918, Mar. 2013.
- [10] J. A. Munoz, J. R R. Espinoza, C. R. Baier, L. L. Morán, E. E. Espinosa, P. E. Melín, and D. G. Sbárbaro, "Design of a discrete-time linear control strategy for a multicell UPQC," *IEEE Trans. Ind. Electron.*, vol. 59, no. 10, pp. 3797–3807, Oct. 2012.
- [11] J. Napoles, J. I. Leon, R. Portillo, L. G. Franquelo, and M. A. Aguirre, "Selective harmonic mitigation technique for high-power Converters," *IEEE Trans. Ind. Electron.*, vol. 57, no. 7, pp. 2315–2323, Jul. 2010.
- [12] L. G. Franquelo, J. Napoles, R. C. Portillo Guisado, J. I. Leon, and M. A. Aguirre, "A flexible selective harmonic mitigation technique to meet grid codes in three-level PWM Converters," *IEEE Trans. Ind. Electron.*, vol. 54, no. 6, pp. 3022–3029, Dec. 2007.
- [13] S. Kouro, M. Malinowski, K. Gopakumar, J. Pou, L. G. Franquelo, and B. Wu, "Recent advances and industrial applications of multilevel converters," *IEEE Trans. Ind. Electron.*, vol. 57, no. 8, pp. 2553–2580, Aug. 2010.
- [14] A. M. Massoud, S. Ahmed, P. N. Enjeti, and B. W. Williams, "Evaluation of a multilevel cascaded-type dynamic voltage restorer employing discontinuous space vector modulation," *IEEE Trans. Ind. Electron.*, vol. 57, no. 7, pp. 2398–2410, Jul. 2010.
- [15] M. Hagiwara, K. Nishimura, and H. Akagi, "A medium-voltage motor drive with a modular multilevel PWM Converter," *IEEE Trans. Power Electron.*, vol. 25, no. 7, pp. 1786–1799, Jul. 2010.
- [16] J. Rodriguez, S. Bernet, B. Wu, J. O. Pontt, and S. Kouro, "Multilevel voltage-source-Converter topologies for industrial medium-voltage drives," *IEEE Trans. Ind. Electron.*, vol. 54, no. 6, pp. 2930–2945, Dec. 2007.
- [17] L. Maharjan, S. Inoue, and H. Akagi, "A transformerless energy storage system based on a cascade multilevel PWM Converter with star configuration," *IEEE Trans. Ind. Appl.*, vol. 44, no. 5, pp. 1621–1630, Sep./Oct. 2008.
- [18] W. Song and A. Q. Huang, "Fault-tolerant design and control strategy for cascaded H-bridge multilevel Converter-based STATCOM," *IEEE Trans. Ind. Electron.*, vol. 57, no. 8, pp. 2700–2708, Aug. 2010.
- [19] E. Villanueva, P. Correa, J. Rodriguez, and M. Pacas, "Control of a singlephase cascaded H-bridge multilevel Converter for grid-connected photovoltaic systems," *IEEE Trans. Ind. Electron.*, vol. 56, no. 11, pp. 4399–4406, Nov. 2009.
- [20] C. Cecati, F. Ciancetta, and P. Siano, "A multilevel Converter for photovoltaic systems with fuzzy logic control," *IEEE Trans. Ind. Electron.*, vol. 57, no. 12, pp. 4115–4125, Dec. 2010.
- [21] C. H. Ng, M. A. Parker, R. Li, P. J. Tavner, J. R. Bumby, and E. Spooner, "A multilevel modular Converter for a large, light weight wind turbine generator," *IEEE Trans. Power Electron.*, vol. 23, no. 3, pp. 1062–1074, May 2008.
- [22] F. Khoucha, S. M. Lagoun, K. Marouani, A. Kheloui, and M. E. H. Benbouzid, "Hybrid cascaded H-bridge multilevel-Converter induction-motordrive direct torque control for automotive applications," *IEEE Trans. Ind. Electron.*, vol. 57, no. 3, pp. 892–899, Mar. 2010.
- [23] L. M. Tolbert, F. Z. Peng, and T. G. Habetler, "Multilevel Converters for large electric drives," *IEEE Trans. Ind. Appl.*, vol. 35, no. 1, pp. 36–44, Jan./Feb. 1999.
- [24] Z. Du, B. Ozpineci, L. M. Tolbert, and J. N. Chiasson, "DC–AC cascaded H-bridge multilevel boost Converter with no inductors for electric/hybrid electric vehicle applications," *IEEE Trans. Ind. Appl.*, vol. 45, no. 3, pp. 963–970, May/Jun. 2009.
- [25] A. K. Gupta and A. M. Khambadkone, "A general space vector PWM algorithm for multilevel Converters, including operation in overmodulation range," *IEEE Trans. Power Electron.*, vol. 22, no. 2, pp. 517–526, Mar. 2007.
- [26] A. K. Gupta and A. M. Khambadkone, "A space vector modulation scheme to reduce common mode voltage for cascaded multilevel Converters," *IEEE Trans. Power Electron.*, vol. 22, no. 5, pp. 1672–1681, Sep. 2007.
- [27] R. Rabinovici, D. Baimel, J. Tomasik, and A. Zuckerberger, "Series space vector modulation for multi-level cascaded H-bridge Converters," *IET Power Electron.*, vol. 3, no. 6, pp. 843–857, Nov. 2010.
- [28] Z. Cheng and B. Wu, "A novel switching sequence design for five-level NPC/H-bridge Converters with improved output voltage spectrum and minimized device switching frequency," *IEEE Trans. Power Electron.*, vol. 22, no. 6, pp. 2138–2145, Nov. 2007.
- [29] B. P. McGrath, D. G. Homes, and T. Lipo, "Optimized space vector switching sequences for multilevel Converters," *IEEE Trans. Power Electron.*, vol. 18, no. 6, pp. 1293–1301, Nov. 2003.

- [30] D.-W. Kang, Y.-H. Lee, B.-S. S. Suh, C.-H. H. Choi, and D.-S. S. Hyun, "An improved carrier-based SVPWM method using leg voltage redundancies in generalized cascaded multilevel Converter topology," *IEEE Trans. Power Electron.*, vol. 18, no. 1, pp. 180–187, Jan. 2003.
- [31] W. Yao, H. Hu, and Z. Lu, "Comparisons of space-vector modulation and carrier-based modulation of multilevel Converter," *IEEE Trans. Power Electron.*, vol. 23, no. 1, pp. 45–51, Jan. 2008.
- [32] M. Ma, L. Hu, A. Chen, and X. He, "Reconfiguration of carrier-based modulation strategy for fault tolerant multilevel Converters," *IEEE Trans. Power Electron.*, vol. 22, no. 5, pp. 2050–2060, Sep. 2007.
- [33] Q. Song and W. Liu, "Control of a cascade STATCOM with star configuration under unbalanced conditions," *IEEE Trans. Power Electron.*, vol. 24, no. 1, pp. 45–58, Jan. 2009.
- [34] P. Lezana and G. Ortiz, "Extended operation of cascade multicell Converters under fault condition," *IEEE Trans. Ind. Electron.*, vol. 56, no. 7, pp. 2697–2703, Jul. 2009.
- [35] L. Maharjan, T. Yamagishi, H. Akagi, and J. Asakura, "Fault-tolerant operation of a battery-energy-storage system based on a multilevel cascade PWM Converter with star configuration," *IEEE Trans. Power Electron.*, vol. 25, no. 9, pp. 2386–2396, Sep. 2010.
- [36] V. Naumanen, J. Luukko, P. Silventoinen, J. Pyrhonen, H. Saren, and K. Rauma, "Compensation of DC link voltage variation of a multilevel series-connected H-bridge Converter," *IET Power Electron.*, vol. 3, no. 5, pp. 793–803, Sep. 2010.
- [37] J. Rodriguez, P. W. Hammond, J. Pontt, R. Musalem, P. Lezana, and M. J. Escobar, "Operation of a medium-voltage drive under faulty conditions," *IEEE Trans. Ind. Electron.*, vol. 52, no. 4, pp. 1080–1085, Aug. 2005.
- [38] Y.-M. Park, H.-S. Ryu, H.-W. Lee, M.-G. Jung, and S.-H. Lee, "Design of a cascaded h-bridge multilevel Converter based on power electronics building blocks and control for high performance," *J. Power Electron.*, vol. 10, no. 3, pp. 262–269, May 2010.
- [39] J. I. Leon, O. Lopez, L. G. Franquelo, J. Doval-Gandoy, S. Vazquez, J. Alvarez, and F. D. Freijedo, "Multilevel multiphase feedforward spacevectormodulation technique," *IEEE Trans. Ind. Electron.*, vol. 57, no. 6, pp. 2066–2075, Jun. 2010.
- [40] R. Gupta, A. Ghosh, and A. Joshi, "Switching characterization of cascaded multilevel-Converter-controlled systems," *IEEE Trans. Ind. Electron.*, vol. 55, no. 3, pp. 1047–1058, Mar. 2008.
- [41] Y. Li and B. Wu, "A novel DC voltage detection technique in the CHB Converter-based STATCOM," *IEEE Trans. Power Del.*, vol. 23, no. 3, pp. 1613–1619, Jul. 2008.
- [42] R. Naderi and A. Rahmati, "Phase-shifted carrier PWM technique for general cascaded Converters," *IEEE Trans. Power Electron.*, vol. 23, no. 3, pp. 1257–1269, May 2008.
- [43] D.-W. Chung, J.-S. Kim, and S.-K. Sul, "Unified voltage modulation technique for real-time three-phase power conversion," *IEEE Trans. Ind. Appl.*, vol. 34, no. 2, pp. 374–380, Mar./Apr. 1998.
- [44] F. Wang, "Sine-triangle versus space-vector modulation for three-level PWM voltage-source Converters," *IEEE Trans. Ind. Appl.*, vol. 38, no. 2, pp. 500–506, Mar./Apr. 2002.
- [45] F. Carnielutti, H. Pinheiro, and C. Rech, "Generalized carrier-based modulation strategy for cascaded multilevel Converters operating under fault conditions," *IEEE Tran*